


PL-PN2-1A-7L / PL-PN2-1B-7L


VERSION 1

Internal Electrical Wiring Diagram

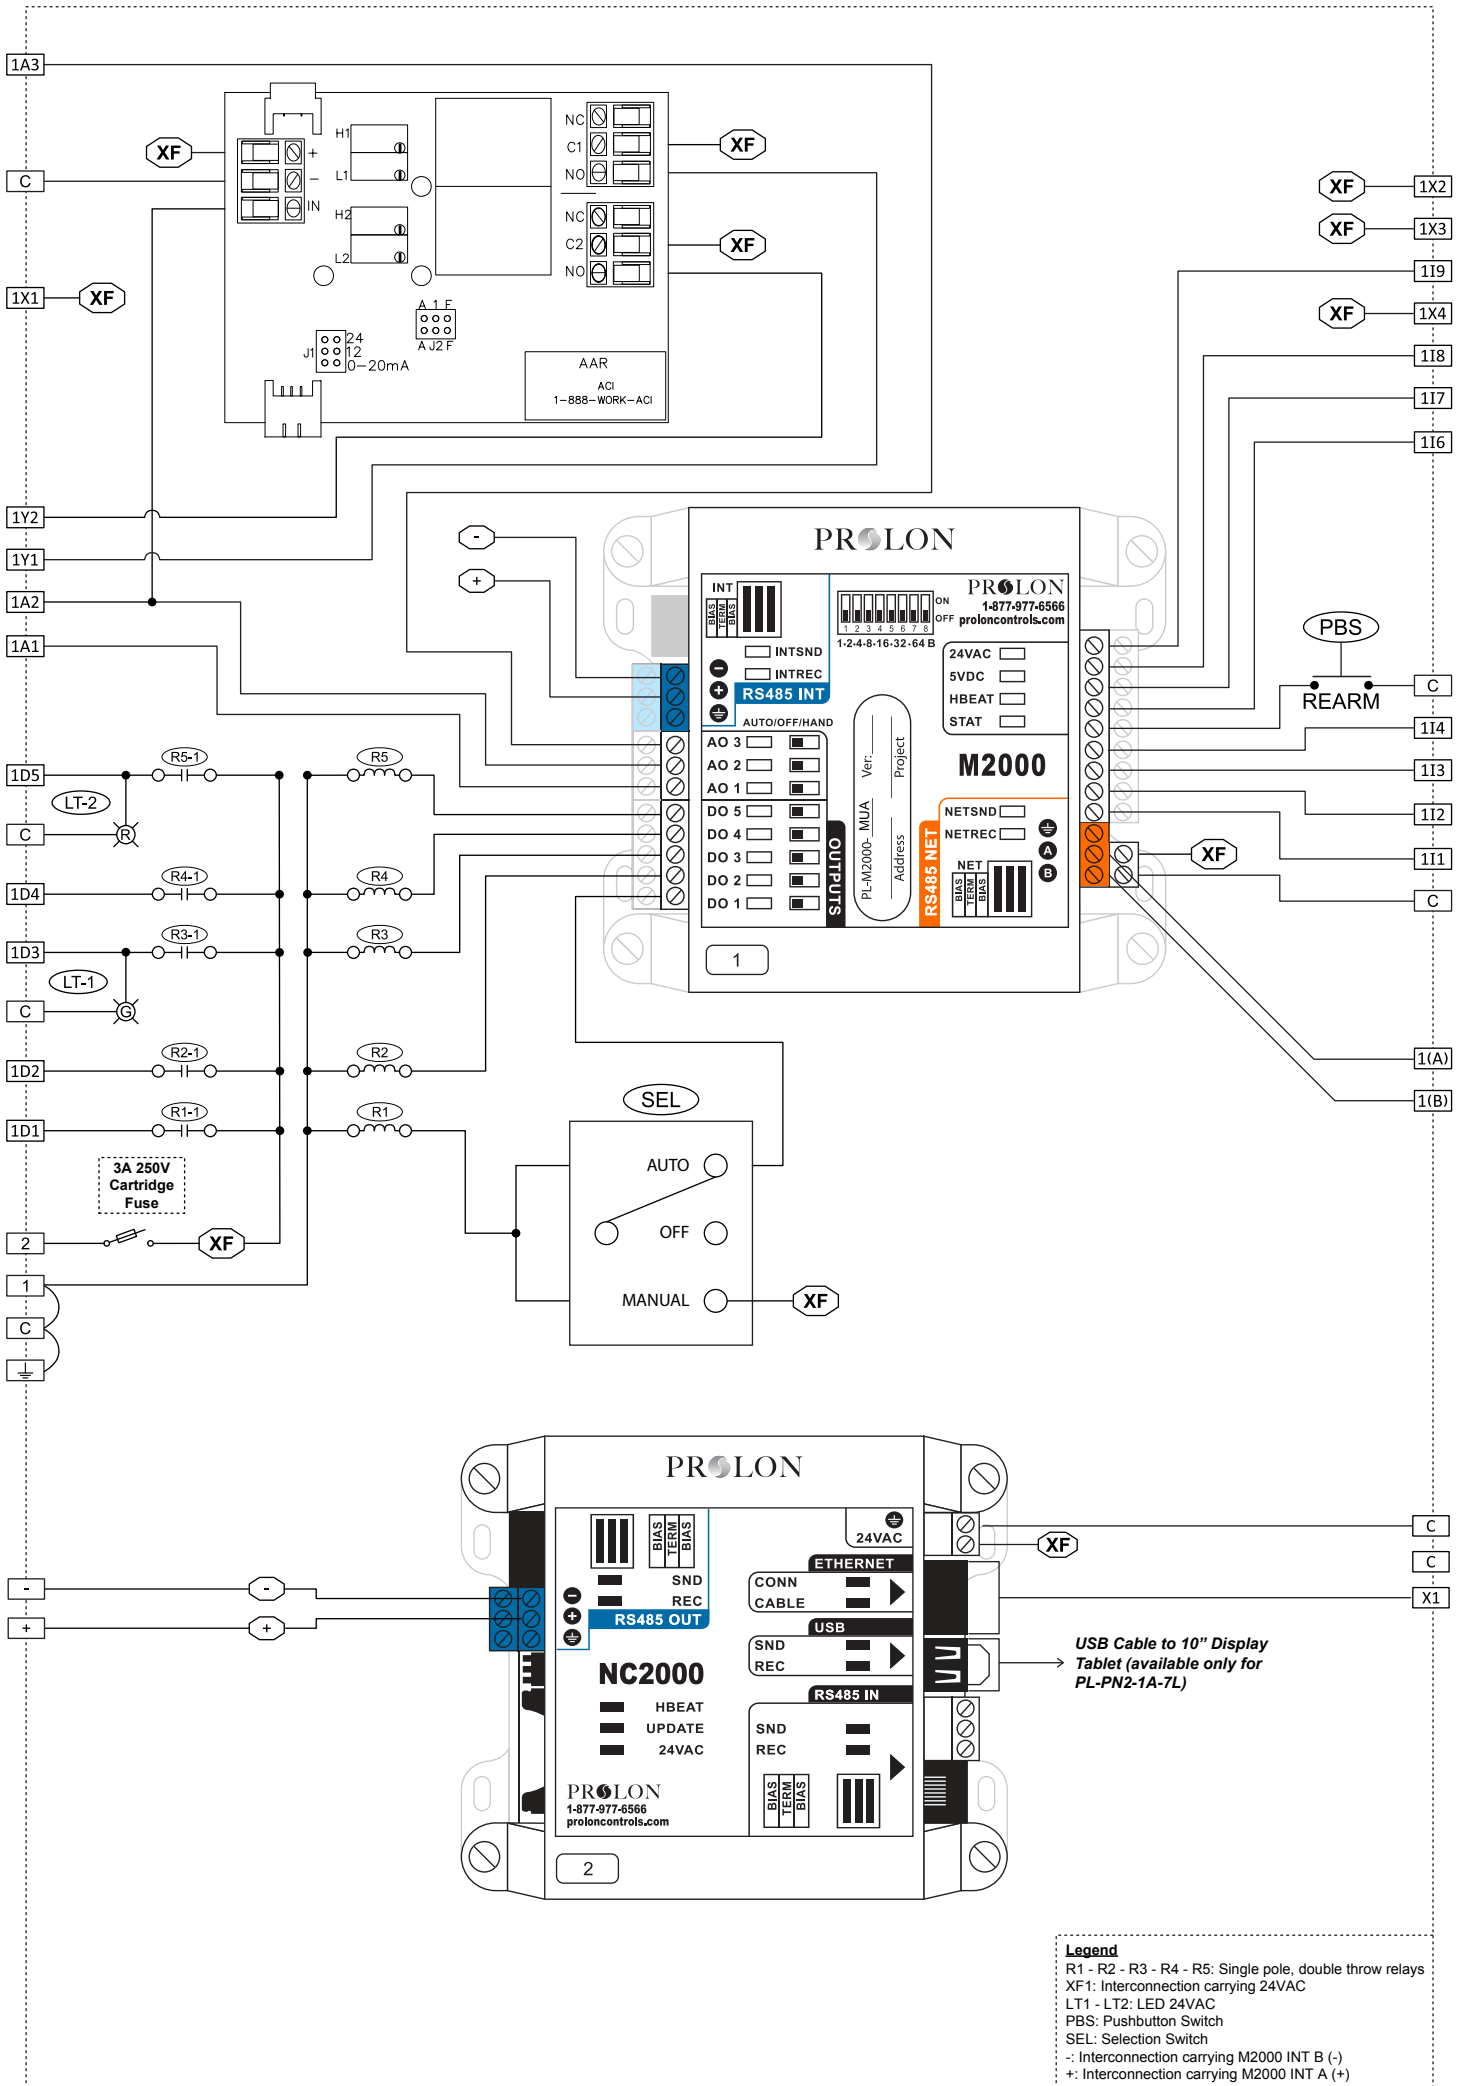

Field Wiring Details

ALL TERMINALS: Use Copper Conductors Only, 105°C/220°F, Maximum Torque Conductor Mounting: 0.5Nm

Terminal	Function	Ratings
	GROUND	N/A
1	Supply Input Common	N/A
2	Supply Input 24VAC	24VAC, 3A, 60Hz
1D1	(R1) - Occupancy Output	24VAC, 300mA
1D2	(R2) - Outside Air Damper Output	24VAC, 300mA
1D3	(R3) - Fan Output	24VAC, 300mA
1D4	(R4) - Preheat Permission Output	24VAC, 300mA
1D5	(R5) - Alarm Output	24VAC, 300mA
1A1	Modulating Heat Output	0-10VDC, 40mA
1A2	Cooling Output / AN	0-10VDC, 40mA
1Y1	Cooling Output / Stage 1	24VAC, 300mA
1Y2	Cooling Output / Stage 2	24VAC, 300mA
1X1	24VAC Supply	24VAC, 8.5VA
1A3	VFD Output	0-10VDC, 40mA
1X2	VFD Supply	24VAC, 5VA
1X3	Static Pressure Sensor Supply	24VAC, 0.03A

Terminal	Function	Ratings
1I9	CO2 / Building Pressure	0-5VDC, 20mA
1X4	CO2 Sensor Supply	24VAC, 6.7VA
1I8	Zone Temperature	N/A
1I7	Outside Temperature	N/A
1I6	Supply Temperature	N/A
1I4	Dry Contact for: Proof of Fan	N/A
1I3	Dry Contact for: Outside Air Damper	N/A
1I2	Dry Contact for: Exhaust 2 / Manual Override	N/A
1I1	Dry Contact for: Exhaust 1	N/A
1(+)	NC2000 / M2000 RS485 INT A (+)	N/A
1(-)	NC2000 / M2000 RS485 INT B (-)	N/A
1(A)	M2000 RS485 NET A (+)	N/A
1(B)	M2000 RS485 NET B (-)	N/A
X1	NC2000 Ethernet Connection (Use CAT5e Patch Cable)	N/A
C	COMMON	N/A